GENERAL NOTES

1.	SEE GI-002 FOR NOTES AND LEGENDS.
2.	PROVIDE PHOTOCELL FOR LIGHTING CONTROL SYSTEM. COORDINATE LOCATION WITH SITE CONDITIONS.

⬡ KEYED NOTES

1	MOUNT OVER ENTRANCE DOORWAY.
2	CONTRACTOR TO ADJUST BRIGHTNESS OF LUMINARIES AS NEEDED.
3	MOUNT IN LOCATION OF PREVIOUSLY REMOVED LUMINARIES. RECONNECT TO EXISTING LIGHTING CIRCUIT.
4	EXTEND WIRING FROM EXISTING LUMINARY LOCATIONS.

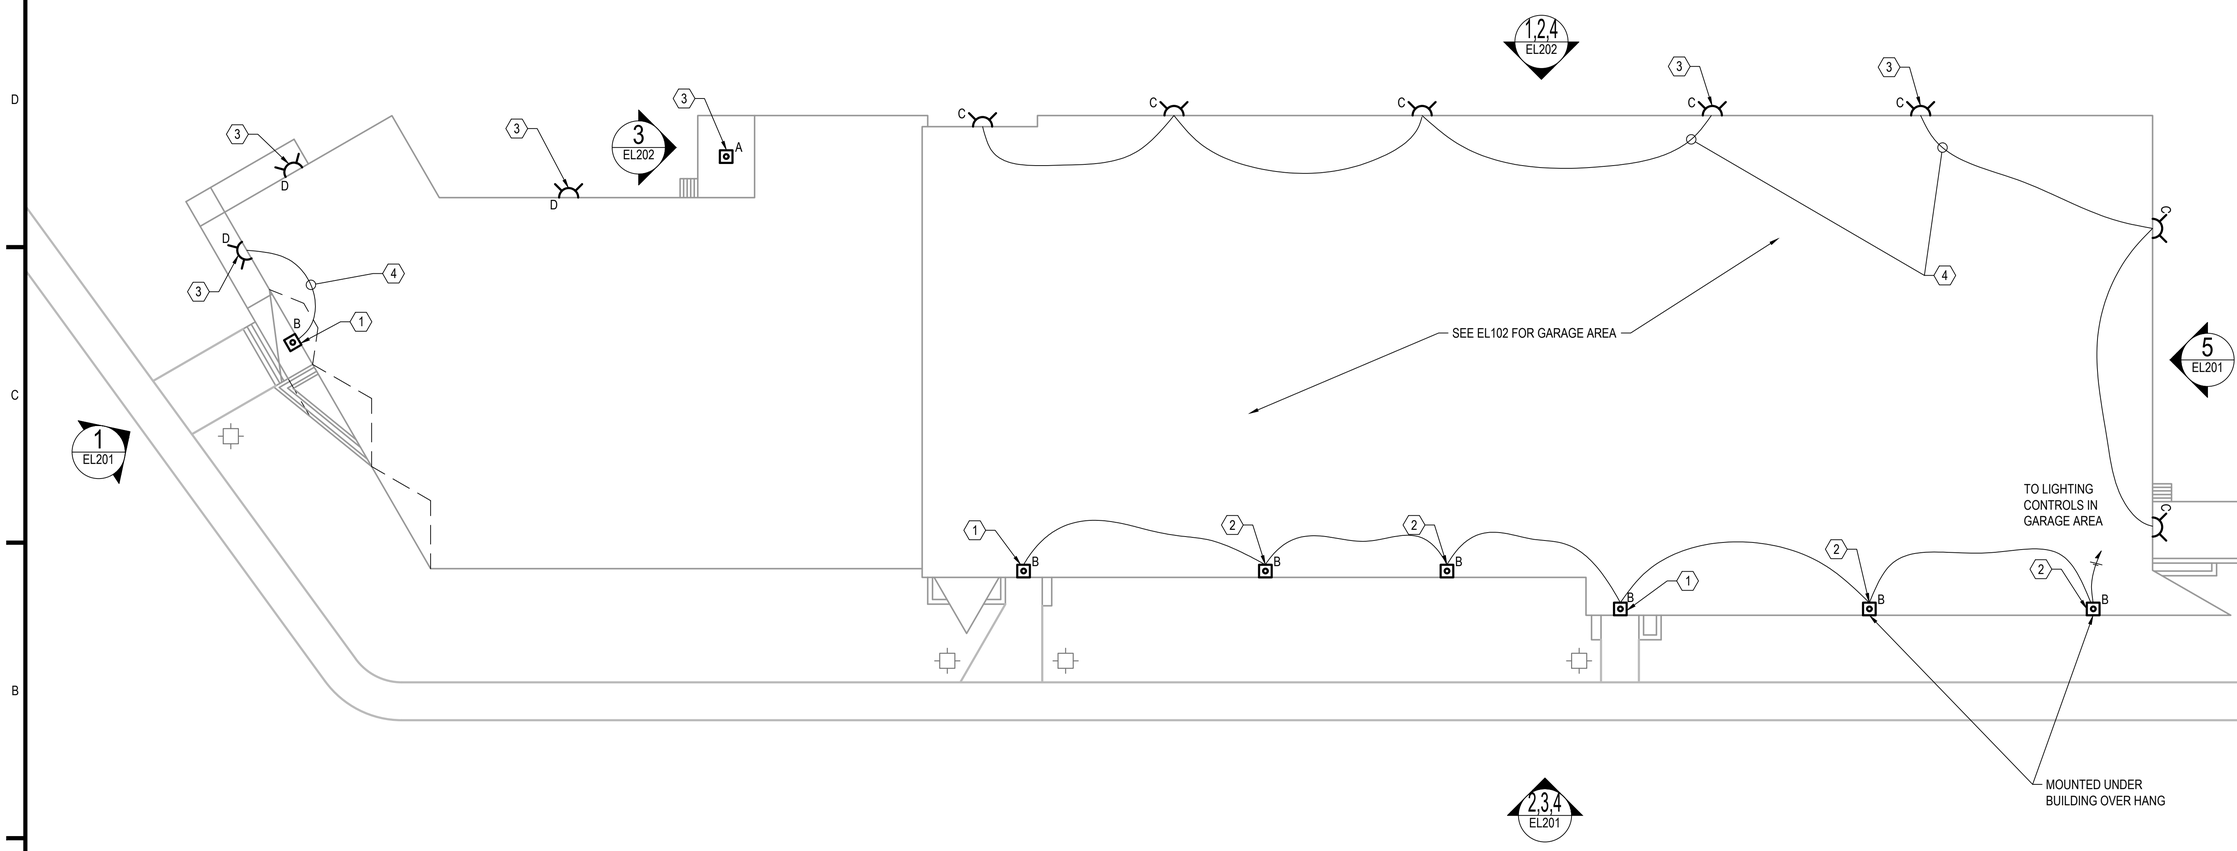

N

1 ELECTRICAL LIGHTING PLAN, SITE

SCALE: 1/16"=1'-0"

ENCORUS GROUP

encorus.com

STATE OF NEW YORK · THOMAS R. GILMARTIN · 085647 · LICENSED PROFESSIONAL ENGINEER

Thomas R. Gilmartin, PE

4/12/2019

Copyright 2019 - Encorus Group Engineering, P.C. all rights reserved. No part of this drawing may be reproduced or copied in any form by any means without the written permission of the engineer. Reproduction of this drawing for use in the production of shop and/or field detail drawings is expressly forbidden.

"Unauthorized alteration or addition to any plans, specifications or reports bearing a Licensed Professional Engineer's seal is a violation of Section 7209, subdivision 2, of the New York State Education Law".

CLIENT:

NYSIF

225 OAK STREET
BUFFALO, NY 14202

PROJECT:

225 OAK ST ENVELOPE REPAIRS

225 OAK STREET
BUFFALO, NY 14202

REVISIONS:

REV	DESCRIPTION	DATE	DFTR	CHKR
0	BID DOCUMENT	2019-04-12	DGA	SBV

PROJECT NUMBER:	18277
DRAFTER:	CJR
CHECKER:	JFF
ENGINEER:	TRG
DRAWING SCALE:	NTS
DRAWING SIZE:	ANSI D

DRAWING TITLE:

ELECTRICAL LIGHTING PLAN SITE

DRAWING NUMBER:

EL101