

ATTACHMENT 5
ITS SPECIFICATIONS - 24 CDW UPS OUTLETS

Two UPS's will be used at 24 Computer drive West.

The first UPS is:

SKU: SRT5KXLT-5KTF

Desc: Schneider Electric APC 5000 Volt Amperage UPS

Quantity Needed: 1

Source: <https://www.apc.com/us/en/product/SRT5KXLT-5KTF/apc-smartups-srt-5kva-208v-tower-w-o-kit-8x-520r-4x-l620r-2x-l630r-1x-l1430r-nema-w-transfo-208-240v-to-120v/?%3Frage=61918-smartups-online&selectedNodeId=27162421315>

The input specs are:

Main Input Voltage 208 V

Product Or Component Type Uninterruptible power supply (UPS)

Other Input Voltage 240 V

Main Output Voltage 208 V



Other Output Voltage 240 V

Kw Rating 4800 W

Rated Power In Va 5400 VA

Input Connection Type NEMA L6-30P

The below outlet must be modified from I5-30-r 30A to L6-30A.

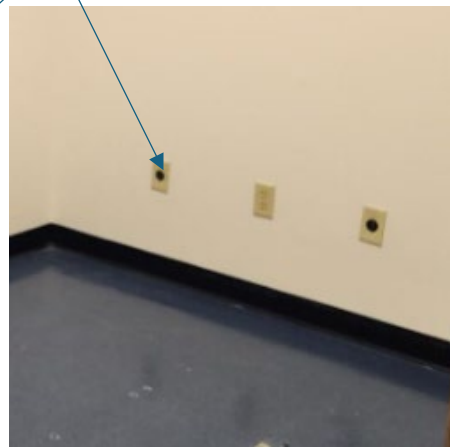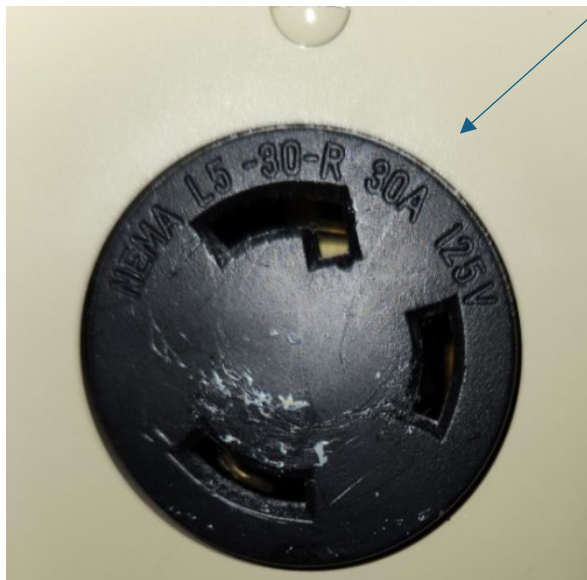

ATTACHMENT 5
ITS SPECIFICATIONS - 24 CDW UPS OUTLETS

The 2nd UPS is:

APC Smart-UPS X SMX1500RM2UCNC , 1

APC Smart-UPS X 48V External Battery Pack,

[APC Smart-UPS X, Line Interactive, 1500VA, Rack/tower convertible 2U, 120V, 8x 5-15R NEMA, SmartConnect port+NMC, Extended runtime - SMX1500RM2UCNC | APC USA](#)

The specs are:

Main Input Voltage 120 V

Main Output Voltage 120 V

Kw Rating 1350 W

Rated power in VA 1440 VA

Input Connection Type NEMA 5-15P

Nb of power socket outlets 8 NEMA 5-15R

Number of rack unit 2U

Cable length 8 ft (2.44 m)

The below outlet must be verified to meet the above criteria.

